


SAMPLE DIAGRAM - FOR REFERENCE ONLY GENERIC - NOT JOB SPECIFIC

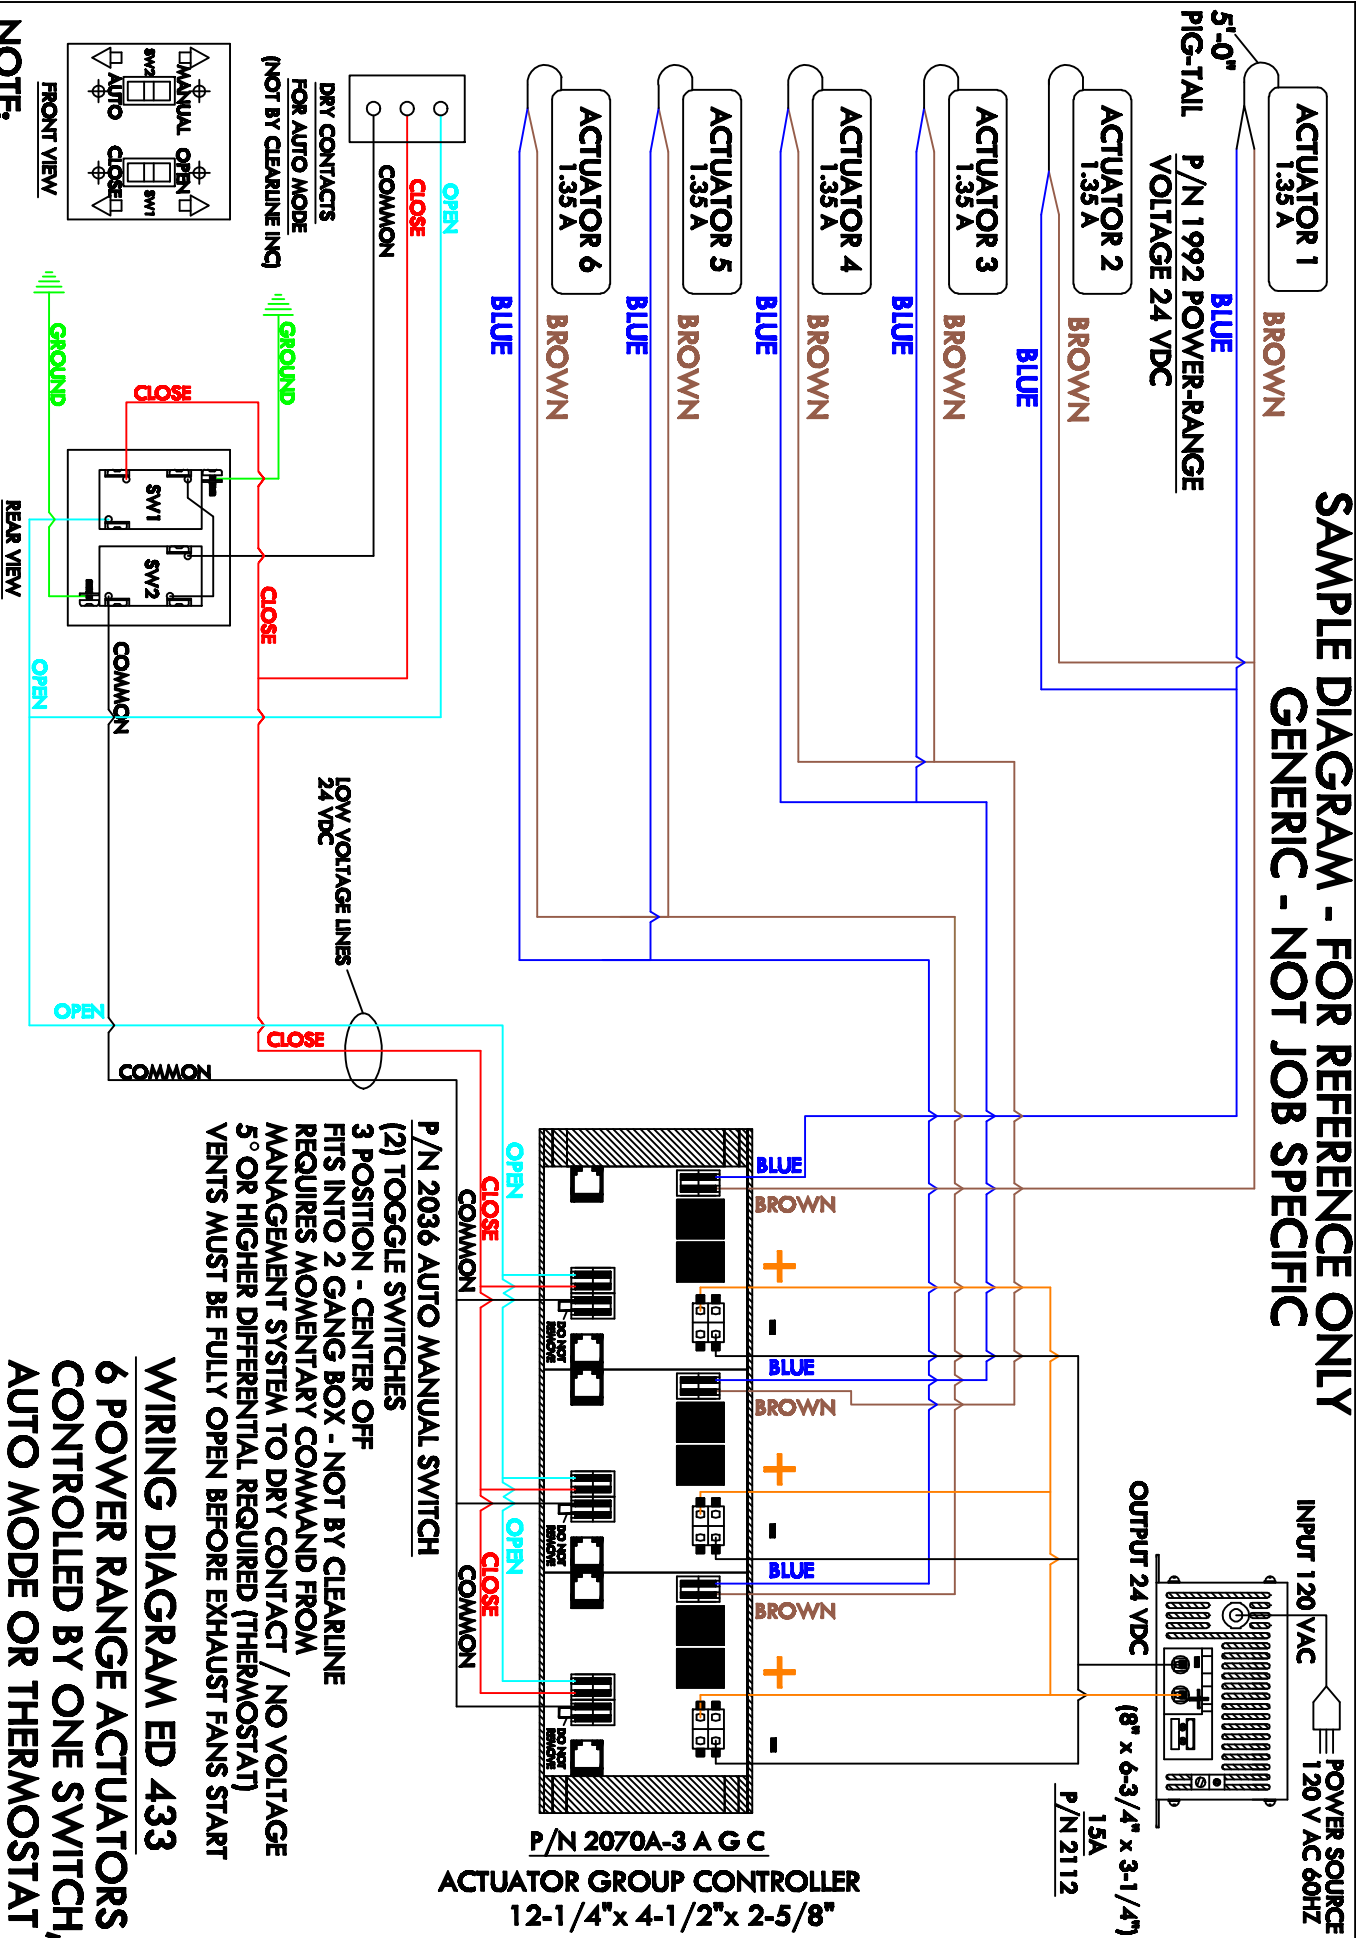

P/N 2036 AUTO MANUAL SWITCH
(2) TOGGLE SWITCHES
3 POSITION - CENTER OFF
FITS INTO 2 GANG BOX - NOT BY CLEARLINE
REQUIRES MOMENTARY COMMAND FROM
MANAGEMENT SYSTEM TO DRY CONTACT / NO VOLTAGE
5° OR HIGHER DIFFERENTIAL REQUIRED (THERMOSTAT)
VENTS MUST BE FULLY OPEN BEFORE EXHAUST FANS START

WIRING DIAGRAM ED 433
6 POWER RANGE ACTUATORS,
CONTROLLED BY ONE SWITCH,
AUTO MODE OR THERMOSTAT
FROM DRY CONTACT
(NOT BY CLEARLINE, INC) 9-10

NOTE:
SWITCH AND POWER SUPPLY CAN BE PLACED AT ANY LOCATION WITHIN 100 FEET.
SWITCH SHOULD BE LOCATED IN A SECURE AREA.

